INTER-LABORATORY COLLABORATIVE TEST : MLB/EX BOZ

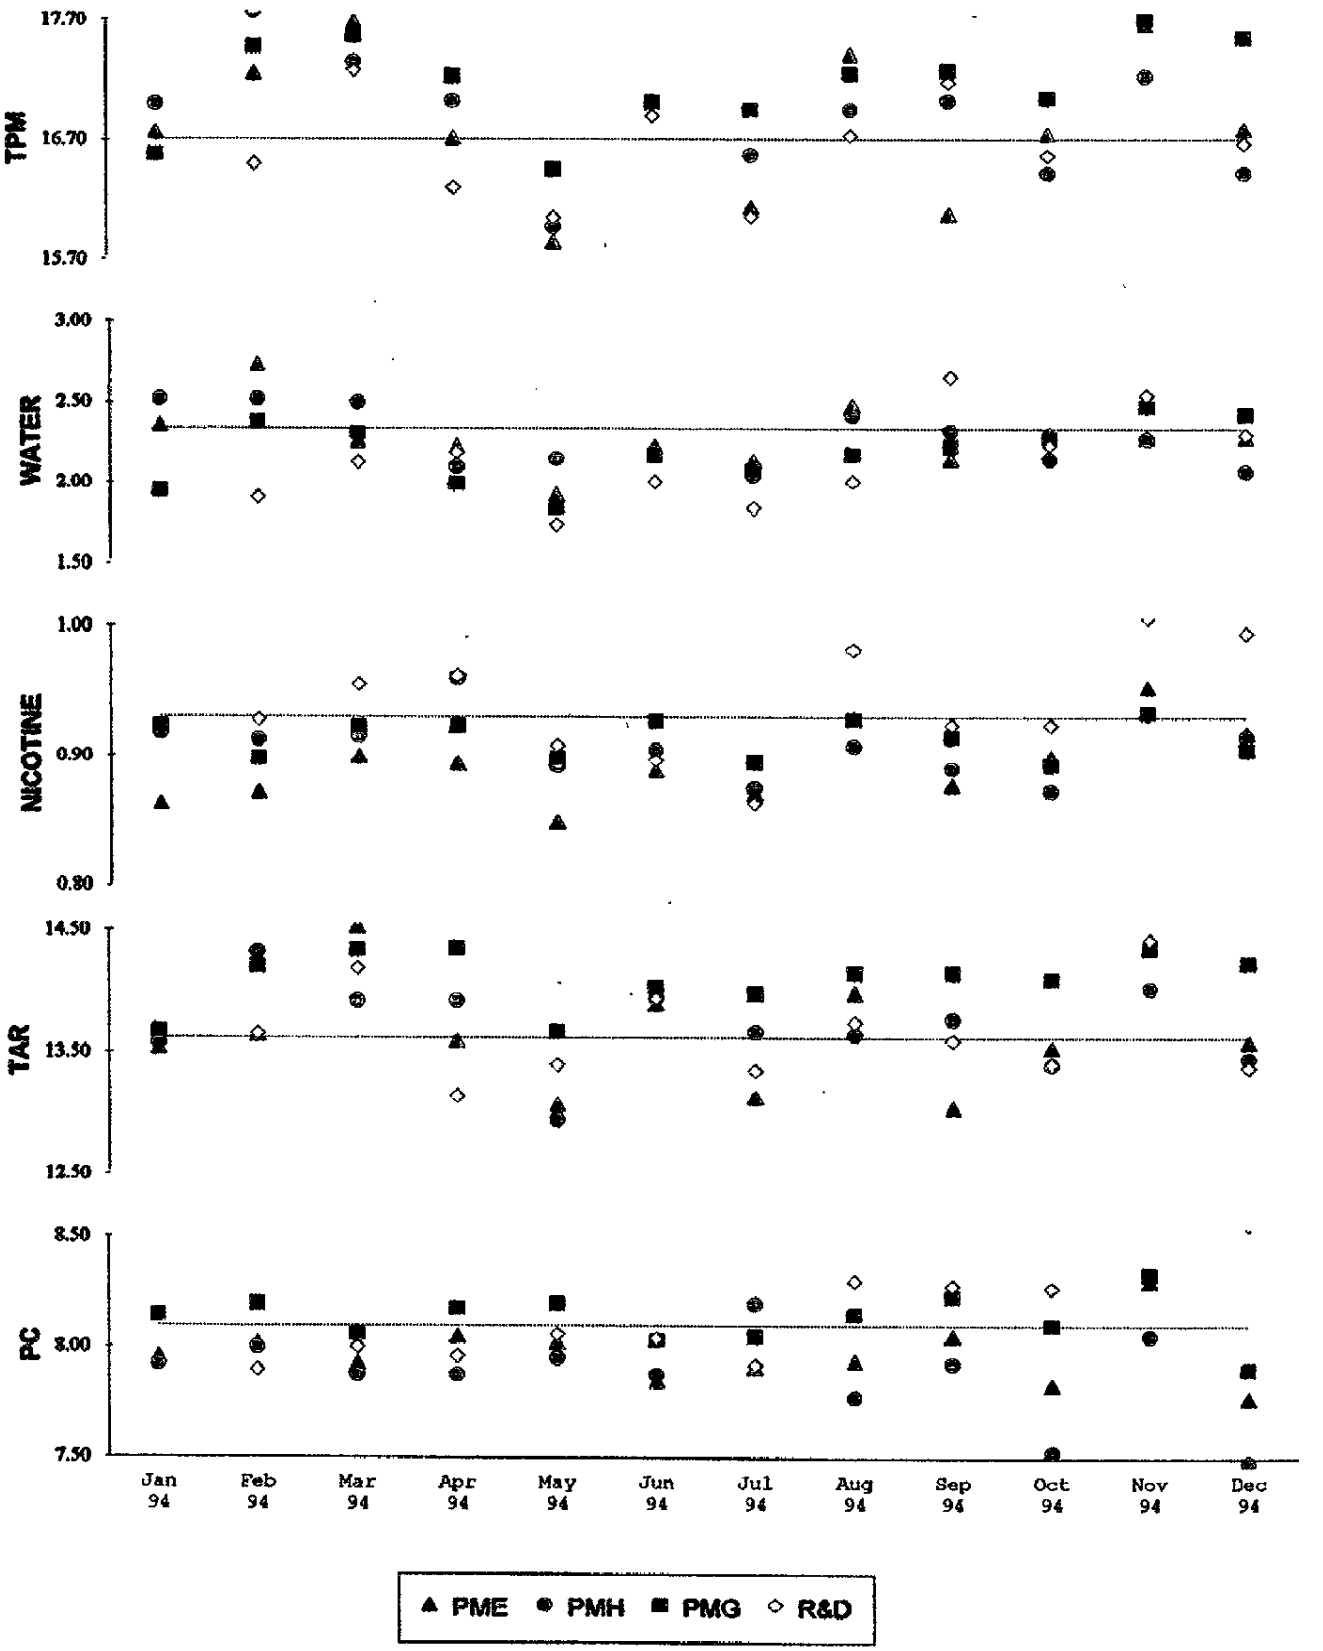

PM3000984813

Source: https://www.industrydocuments.ucsf.edu/docs/ntlk0001